



# RECOMMENDED FLUORESCENT WIRING

## WITHOUT STARTER

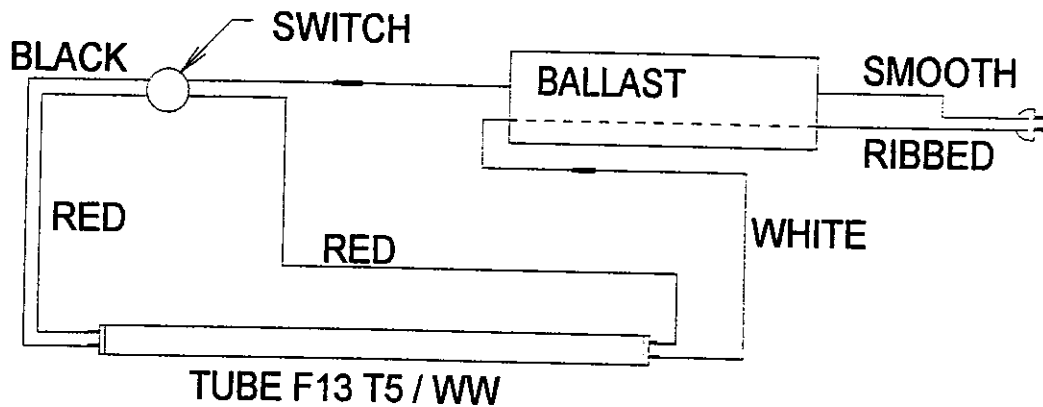

## WITH STARTER

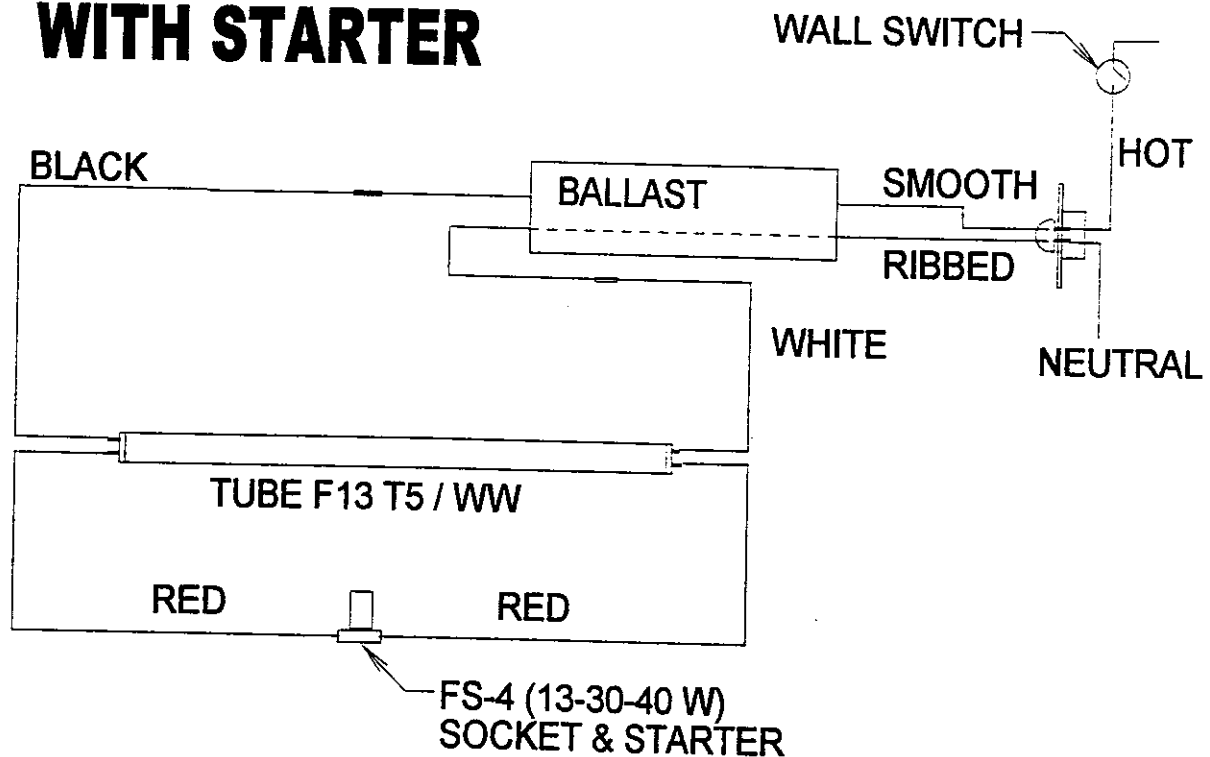

**ORGAN SUPPLY INDUSTRIES**  
**10/12/99**