



TILTING TABLET ASSEMBLY


Part Numbers

0101.00 (TTA)

5575.01-02 (Tilting Tablet Magnet)

The Tilting Tablet Assembly is provided with Pancon .156, 8 position insulation displacement connectors for ease of wiring to 24 gauge PVC wire. Also provided is a wire insertion tool.

1. Organ 13VDC (nominal) must connect to both Positive (terminal A) and Negative (terminal B). This powers the Hall Effect sense switch in the magnet.
2. The tilting tablet magnets are provided with a positive OR negative common which you specified on your Tilting Tablet Check Sheet. The common polarity is noted on the top of the magnet.
3. The On Coil (terminal C) and Off Coil (terminal D) terminals power the on and off functions of the tilting tablet.
4. There are 2 Sense terminals. The Sense In (terminal F) must be bridged to the Positive (A) OR Negative (B) terminal at the top of the magnet. Your selection will provide the Sense output polarity (G) required by your control system.

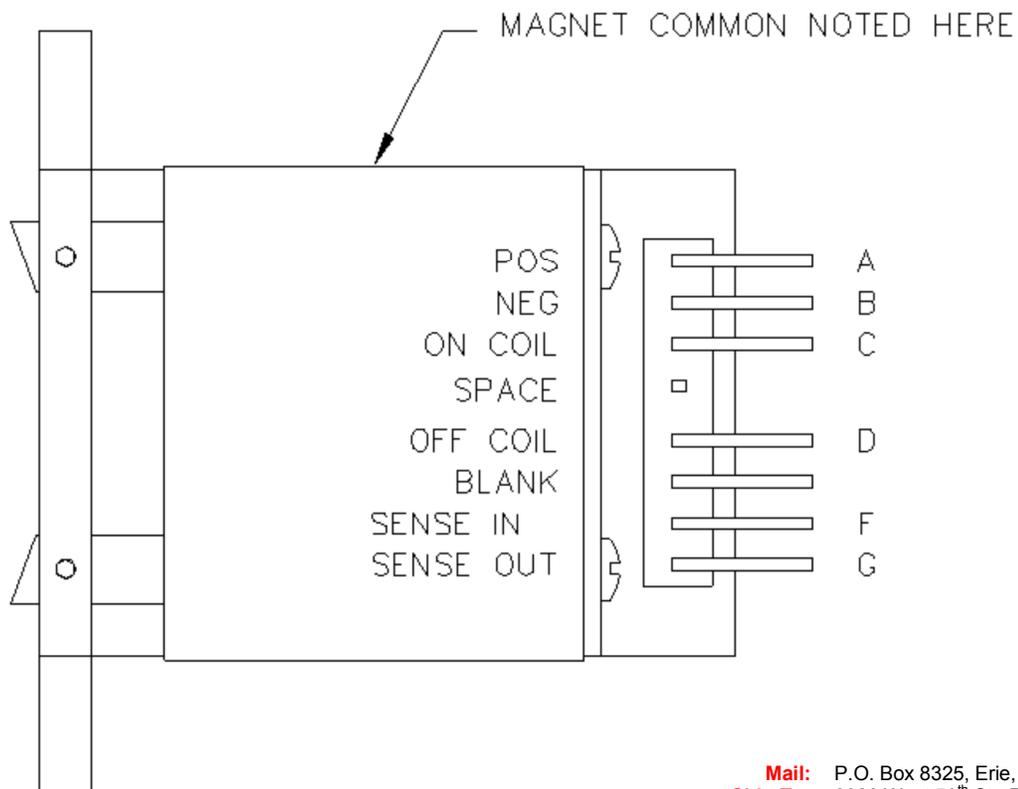

Mail: P.O. Box 8325, Erie, PA 16505-0325
Ship To: 2320 West 50th St., Erie, PA 16506-4928
Voice: (814) 835-2244 / (800) 458-0289
Fax: (814) 838-0349
Web: www.organsupply.com
Email: osi@organsupply.com